



WHY IS THIS WORK NECESSARY?

- Maintain adequate fire protection
- No existing main along W 1st between SW Taylor and SW Polk
- Existing 12" water main under I-70 will be removed with KDOT project





WHY IS THIS WORK NECESSARY?








WHAT IMPROVEMENTS WILL BE MADE?

- New 6" PVC piping from SW Taylor to SW Polk
- New branch piping at SW Taylor and SW Polk
- Connections to existing 2" main on SW Taylor, 4" main on W 1st, and 10" main on SW Polk
- New water services (main to meter)





WHAT IMPROVEMENTS WILL BE MADE?

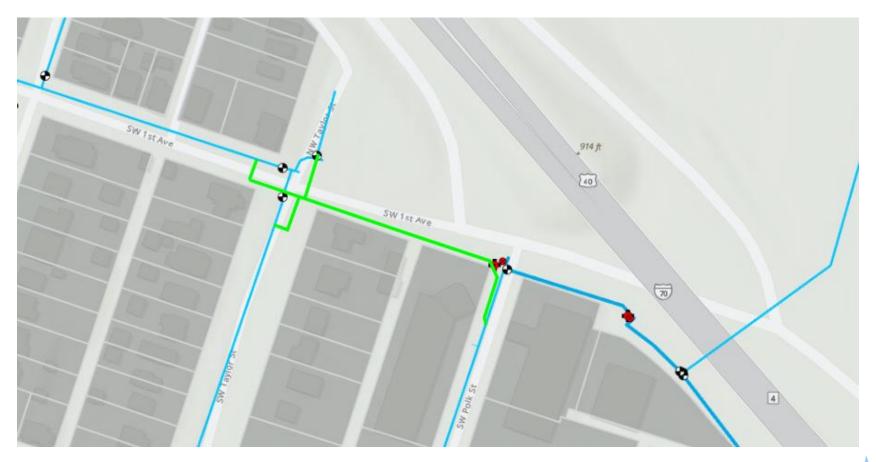






WHAT SHOULD YOU EXPECT?

- Two phases beginning at SW Polk
- Travel restricted; W 1st closed from SW Taylor to SW Polk
- Large, noisy equipment
- Flowing water during flushing
- Brief interruption in water service





WHAT SHOULD I EXPECT?

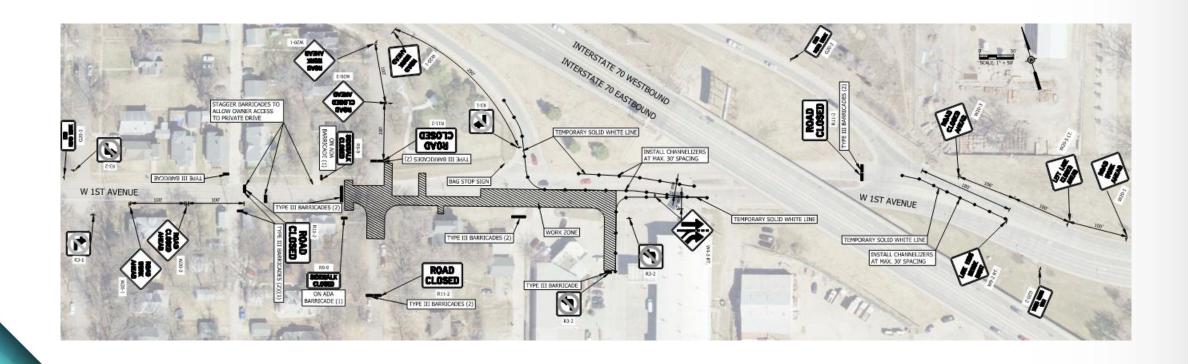





PROJECT SCHEDULE

- Construction Start: October 30, 2023
- Construction Complete: January 11, 2024
- Normal work hours 7:00 to 4:00, Mon thru Fri
- Work outside normal hours with approval
- No holidays





CONTACT INFORMATION

City of Topeka Utilities:

 Duncan Theuri | Project Engineer 785-368-0152 dtheuri@topeka.org

City of Topeka Utilities:

 Tim McCormick | Construction Inspection Mgr. 785-368-2409 tmccormick@topeka.org

Bartlett & West:

 Cory Schoffelman | Design Engineer 785-272-2252 cory.schoffelman@bartwest.com

FIT Excavating:

 Kory James | Project Manager 913-845-2121 office@fitexc.com









